



UL, ULC, CSFM Listed; FM Approved, MEA (NYC) Acceptance\* 4100ES Addressable Fire Detection and Control Basic Panel Modules and Accessories

### **Features**



Figure 1: 4100ES Cabinets are available with one, two or three bays (two bay cabinet shown)

### Master Controller (top) bay:

- 32-Bit Master Controller with color-coded operator interface including raised switches for high confidence feedback
- Dual configuration program CPU, convenient service port access, and capacity for up to 2500 addressable points
- CPU assembly includes 2 GB dedicated compact flash memory for onsite system programming and information storage
- System power supply (SPS) and charger (9 A total) with on-board: NACs IDNet addressable device interface, programmable auxiliary output and alarm relay
- Available with InfoAlarm Command Center expanded content user interface, refer to data sheet S4100-0045
- Upgrade kits are available for existing control panels

### **Network compatibility:**

Compatible with Simplex ES Net or 4120 Fire Alarm Networks

#### Standard addressable interfaces include:

- IDNet addressable device interface with 250 points that support TrueAlarm analog sensing and operate with either shielded or unshielded twisted pair wiring
- Remote annunciator module support through the RUI+ (remote unit interface) communications port

### Optional modules include:

- Building Network Interface Module (BNIC) for Ethernet connectivity options, refer to data sheet \$4100-0061
- Electrically isolated output IDNet 2 (two loop) and IDNet 2+2 (four loop) modules with short circuit isolation output loops allowing use with either shielded or unshielded, twisted or untwisted single pair wiring

- Fire Alarm Network Interfaces, DACTs, city connections, and up to five RS-232 ports for printers and terminals
- IP communicator compatibility
- MAPNET II addressable device modules and MAPNET II quad isolator modules
- Alarm relays, auxiliary relays, additional power supplies, IDC modules, NAC expansion modules
- Service modems, VESDA Air Aspiration Systems interface, ASHRAE BACnet Interface, TCP/IP Bridges
- · LED/switch modules and panel mount printers
- Emergency communications systems (ECS) equipment; 8 channel digital audio or 2 channel analog audio
- Battery brackets for seismic area protection
- 8-point zone/relay module, each point is selectable as an IDC input or relay output. Class A IDCs require two points (one out and one return). Relays rated for 2 A @ 30 VDC (resistive) and configurable as either normally open or normally closed.
- Compatible with Simplex remotely located 4009 IDNet NAC Extenders, up to ten per IDNet SLC

### **Listings information**

- UL 864, Fire Detection and Control (UOJZ), Smoke Control Service (UUKL), Releasing Device Service (SYZV)
- · UL 1076, Proprietary Alarm Units Burglar (APOU)
- UL 2017, Process Management Equipment (QVAX), Emergency Alarm System Control Units (FSZI)
- · UL 1730, Smoke Detector Monitor (UULH)
- UL 2572, Mass Notification Systems (PGWM)
- CAN/ULC-S527 Control Units for Fire Alarm Systems (UOJZ7), Releasing Device Service (SYZV7)
- ULC/ORD-C1076 Proprietary Burglar Alarm Units and Systems (APOU7)
- ULC/ORD-C100 Smoke Control System Equipment (UUKL7)

### **Software Feature Summary**

### **CPU** provides dual configuration programs

- Two programs allow for optimal system protection and commissioning efficiency with one active program and one reserve
- Downtime is reduced because the system stays running during download

### PC based programmer features

- Convenient front panel accessed Ethernet port for quick and easy download of site-specific programming
- Modifications can be uploaded as well as downloaded for greater service flexibility
- Firmware enhancements are made through software downloads to the on-board flash memory

### **Operator interface features**

- TrueAlarm individual analog sensing with front panel information and selection access
- "Dirty" TrueAlarm sensor maintenance alerts, service and status reports including "almost dirty"
- TrueAlarm magnet test indication appears as distinct "test abnormal" message on display when in test mode
- TrueAlarm sensor peak value performance report
- **Install Mode** allows grouping of multiple troubles for uninstalled modules and devices into a single trouble condition, typical with future

<sup>\*</sup> See module information sections for product that is UL or ULC listed and additional listing information. This product has been listed by the California State Fire Marshal (CSFM) pursuant to Section 13144.1 of the California Health and Safety Code. See CSFM Listing 7165-0026:251(4100ES) for allowable values and/or conditions concerning material presented in this document. Accepted for use - City of New York Department of Buildings - MEA35-93E. At the time of publication only UL and ULC listings are applicable to ES Net network products. Additional listings may be applicable; contact your local Simplex product supplier for the latest status. Listings and approvals under Simplex Time Recorder Co. are the property of Tyco Fire Protection Products.



phased expansion; with future equipment and devices grouped into a single trouble, operators can more clearly identify events from the commissioned and occupied areas

- Module level ground fault searching assists installation and service by locating and isolating modules with grounded wiring
- Recurring Trouble Filtering allows the panel to recognize, process, and log recurring intermittent troubles, such as external wiring ground faults, but only sends a single outbound system trouble to avoid nuisance communications
- WALKTEST silent or audible system test performs an automatic selfresetting test cycle

### Introduction

4100ES Series Fire Detection and Control Panels provide extensive installation, operator, and service features with point and module capacities suitable for a wide range of system applications. An onboard Ethernet port provides fast external system communications to expedite installation and service activity. Dedicated compact flash memory archiving provides secure on-site system information storage of electronic job configuration files.

### Modular design

A wide variety of functional modules are available to meet specific system requirements. Selections allow panels to be configured for either Stand-Alone or Networked fire control operation. InfoAlarm Command Center options provide convenient expanded display content, detailed on data sheet *S4100-0045*.

### **Module Bay Description**

**The Master Controller Bay** (top) includes a standard multi-featured system power supply, the master controller board, and operator interface equipment.

**The Expansion Bays** include a Power Distribution Interface (PDI) for new 4 in. x 5 in. flat design option modules and also accommodate 4100-style modules.

**The Battery Compartment** (bottom) accepts two batteries, up to 50 Ah, to be mounted within the cabinet without interfering with module space.

The following illustration identifies bay locations using a three bay cabinet for reference.

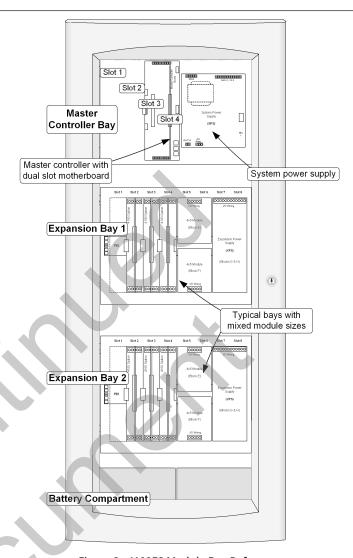


Figure 2: 4100ES Module Bay Reference

Page 2 S4100-0031 Rev. 42 11/2019



### **Mechanical Description**

- Boxes can be close-nippled; each box provides convenient stud markers for drywall thickness and nail-hole knockouts for quicker mounting
- Smooth box surfaces are provided for locally cutting conduit entrance holes exactly where required
- Cabinet assembly design has been seismic tested and is certified to IBC and CBC standards as well as to ASCE 7 categories A through F, requires 4100-7912 option for additional legacy card stabilizer brackets and battery brackets as detailed on data sheet \$2081-0019
- The latching dress panel (retainer) assembly easily lifts off for internal access
- NACs are mounted directly on power supply assemblies providing minimized wiring loss, compact size, and readily accessible terminations
- Packaging supports traditional 4100-style motherboard with daughter cards
- Modules are power-limited (except as noted, such as relay modules)
- The NEMA 1/IP30 box is ordered separately and available for early installation
- Doors are available with tempered glass inserts or solid; boxes and doors are available in platinum or red
- Boxes and door/retainer assemblies are ordered separately per system requirements; refer to data sheet \$4100-0037 for details

### **Operator Interface Detail Reference**

The following illustration identifies the primary functions of the operator interface.

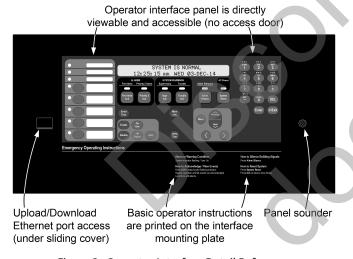


Figure 3: Operator Interface Detail Reference

### **Compatible Peripheral Devices**

The 4100ES is compatible with an extensive list of remote peripheral devices including printers, CRT/keyboards (up to five total), and both conventional and addressable devices including TrueAlarm analog sensors

### Addressable Device Control

### Overview

The 4100ES provides standard addressable device communications for IDNet compatible devices and accepts optional modules for communications with MAPNET II compatible devices. Using a two wire communications circuit, individual devices such as manual fire alarm stations, TrueAlarm sensors, conventional IDC zones, and sprinkler

waterflow switches can be interfaced to the addressable controller to communicate their identity and status.

Addressability allows the location and condition of the connected device to be displayed on the operator interface LCD and on remote system annunciators. Additionally, control circuits (fans, dampers, etc.) may be individually controlled and monitored with addressable devices.

### **Addressable Operation**

Each addressable device on the communication channel is continuously interrogated for status condition such as: normal, off-normal, alarm, supervisory, or trouble. Both Class B and Class A operation are available. Sophisticated poll and response communication techniques ensure supervision integrity and allow for "T-tapping" of the circuit for Class B operation. Devices with LEDs pulse the LED to indicate receipt of a communications poll and can be turned on steady from the panel.

### **IDNet Channel Capacity**

The CPU bay system power supply (SPS) provides an IDNet signaling line circuit (SLC) that supports up to 250 addressable monitor and control points intermixed on the same pair of wires. Additional 250 point IDNet circuit modules are available, see Table 16.

Table 1: IDNet, MAPNET II, IDNet 2, and IDNet 2+2 SLC Wiring Common Specifications

| Specification                         |               | Description  |
|---------------------------------------|---------------|--|
| Maximum Distance                      | 1 to 125      | 4000 ft (1219 m); 50 ohms  |
| from Control Panel per<br>Device Load | 126 to<br>250 | 2500 ft (762 m); 35 ohms   |
| Connections                           |               | Terminals for 18 to 12 AWG (0.82 mm <sup>2</sup> to 3.31 mm <sup>2</sup> ) |

**Table 2: IDNet and MAPNET II Specifications** 

| Specification         |                      | Description                     |  |  |
|-----------------------|----------------------|---------------------------------|--|--|
| Wire Type             | Preferred            | Shielded twisted pair (STP)     |  |  |
| Wire Type             | Acceptable           | Unshielded twisted pair (UTP)   |  |  |
| <b>IDNet and MAPN</b> | IET II Wiring, Total |                                 |  |  |
| Wire Length Allo      | wed With "T" Taps    | Up to 10,000 ft (3 km); 0.58 μF |  |  |
| for Class B Wirin     | g                    |                                 |  |  |

Table 3: IDNet 2 and IDNet 2+2 Wiring Specifications

| Specification   | Description                                       |
|---|---|
| Wire Type   | Shielded or unshielded, twisted or untwisted wire |
| Total Wire Length Allowed With "T" Taps for Class B Wiring                                      | Up to 12,500 ft (3.8 km); 0.60 μF                 |
| Maximum Capacitance Between IDNet 2 Channels  | 1 μF  |
| IDNet 2 and IDNet 2+2 Module Con<br>devices and TrueAlarm sensors incl<br>QuickConnect2 sensors |   |

**Note:** Some applications may require shielded wiring. Review your system with your local Simplex product supplier.

# **TrueAlarm System Operation**

Addressable device communications include operation of TrueAlarm smoke and temperature sensors. Smoke sensors transmit an output value based on their smoke chamber condition and the CPU maintains a current value, peak value, and an average value for each sensor. Status is determined by comparing the current sensor value to its average value. Tracking this average value as a continuously shifting reference point filters out environmental factors that cause shifts in sensitivity.

**Programmable sensitivity** of each sensor can be selected at the control panel for different levels of smoke obscuration (shown directly in percent) or for specific heat detection levels. To evaluate whether the sensitivity should be revised, the peak value is stored in memory and can be easily read and compared to the alarm threshold directly in percent.

Page 3 S4100-0031 Rev. 42 11/2019



**CO sensor bases** combine an electrolytic CO sensing module with a TrueAlarm analog sensor to provide a single multiple sensing assembly using one system address. The CO sensor can be enabled/disabled, used in LED/Switch modes and custom control, and can be made public for communication across a fire alarm Network. For more details, refer to data sheet *\$4098-0052*.

**TrueAlarm heat sensors** can be selected for fixed temperature detection, with or without rate-of-rise detection. Utility temperature sensing is also available, typically to provide freeze warnings or alert to HVAC system problems. Readings can selected as either Fahrenheit or Celsius

### **TrueSense Early Fire Detection**

Multi-sensor 4098-9754 provides photoelectric and heat sensor data using a single 4100ES IDNet address. The panel evaluates smoke activity, heat activity, and their combination, to provide TrueSense early detection. For more details on this operation, refer to data sheet *\$4098-0024*.

### **Diagnostics and Default Device Type**

### **Sensor Status**

TrueAlarm operation allows the control panel to automatically indicate when a sensor is almost dirty, dirty, and excessively dirty. The NFPA 72 requirement for a test of the sensitivity range of the sensors is fulfilled by the ability of TrueAlarm operation to maintain the sensitivity level of each sensor. CO Sensors track their 10 year active life status providing indicators to assist with service planning. Indicators occur at: 1 year, 6 months, and when end of life is reached.

#### **Modular TrueAlarm sensors**

TrueAlarm sensors use the same base and different sensor types (smoke or heat sensor) and can be easily interchanged to meet specific location requirements. This allows intentional sensor substitution during building construction when conditions are temporarily dusty. Instead of covering smoke sensors (causing them to be disabled), heat sensors may be installed without reprogramming the control panel. The control panel will indicate an incorrect sensor type, but the heat sensor will operate at a default sensitivity to provide heat detection for building protection at that location.

# **CPU Bay Module Details**

### **Master Controller and Motherboard**

- Mounts in Slot 4 of a two slot motherboard (Slots 3 and 4 of the Master Controller Bay) and provides one Class B or Class A, RUI+ communications channel configurable for isolated or un-isolated operation
- Slot 3 of the motherboard is primarily for a modular network interface card, or secondarily for the 4100-6038 dual RS-232 board
- RUI communications controls up to 31 devices per master controller (on one or multiple RUI+ and RUI channels); devices include: MINIPLEX transponders, 4603-9101 LCD Annunciators, 4602-9101 Status Command Units (SCU), 4602-9102 Remote Command Units (RCU), 4602 Series LED Annunciator Panels, and 4100 Series 24 I/O and LED/ Switch modules.

**Note:** 4602 series annunciators require un-isolated communications

- Up to four RUI channels (combination of built-in RUI+ and optional RUI modules) are supported per master controller
- Optional Service Modem 4100-6030 mounts onto the master controller board with its own on-board connections

### **System Power Supply**

Page 4

- Rating is 9 A total with "Special Application" appliances; 4 A total for "Regulated 24 DC" appliance power
- · Outputs are power-limited, except for the battery charger

- Provides system power, battery charging, auxiliary power, auxiliary relay, earth detection, on-board IDNet communications channel for 250 points, three on-board NACs, and provisions for either an optional City Connect Module or an optional Alarm Relay Module
- IDNet SLC Output provides Class B or Class A communications for up to 250 addressable devices, as described in Addressable Device Control
- Three, 3 A On-Board NACs, conventional reverse polarity operation; rated 3 A for Special Application appliances and 2 A for Regulated 24 DC power, with electronic control and overcurrent protection; selectable as Class B or Class A, and for synchronized strobe or SmartSync horn/strobe operation over two wires
- NACs are selectable as auxiliary power outputs derated to 2 A for continuous duty; total auxiliary power output per SPS is limited to 5 A
- Battery Charger is dual rate, temperature compensated, and charges up to 50 Ah sealed lead-acid batteries mounted in the battery compartment (33 Ah for single bay cabinets); also is UL listed for charging up to 110 Ah batteries mounted in an external cabinet, refer to data sheet \$2081-0012 for details
- **Battery and Charger Monitoring** includes battery charger status and low or depleted battery conditions; status information provided to the master controller includes analog values for: battery voltage, charger voltage and current, actual system voltage and current, and individual NAC currents
- 2 A Auxiliary Power Output is selectable for detector reset, door holder, or coded output operation
- Auxiliary Relay is selectable as N.O. or N.C., rated 2 A @ 32 VDC, and is programmable as a trouble relay, either normally energized or normally de-energized, or as an auxiliary control
- **Optional City Connect Module** (4100-6031, with disconnect switches, or 4100-6032, without disconnect switches) can be selected for conventional dual circuit city connections
- Optional Alarm Relay Module (4100-6033) provides three Form C relays that are used for Alarm, Trouble, and Supervisory, rated 2 A resistive @ 32 VDC

# 8-Point Zone/Relay Module Details

- Select as IDC or Relay; configure up to eight Class B IDCs, or up to four Class A IDCs; or up to eight Relay outputs rated 2 A resistive @ 30 VDC (N.O. or N.C.); or combinations of IDCs and Relays; each zone is separately configurable as an IDC or Relay output
- IDC Support: each IDC supports up to 30, two-wire devices. Zone relay modules may be powered directly from the control unit power supply or through the optional 25 VDC regulator module where required for two-wire detector compatibility. Refer to 2-Wire Detector Compatibility document 579-832 for additional details.
- IDC EOL resistor values are selectable as: 3.3 k $\Omega$ , 2 k $\Omega$ , 2.2 k $\Omega$ , 3.4 k $\Omega$ , 3.9 k $\Omega$ , 4.7 k $\Omega$ , 5.1 k $\Omega$ , 5.6 k $\Omega$ , 6.34/6.8 k $\Omega$ , and 3.6 k $\Omega$  + 1.1 k $\Omega$ ; see instructions for more details

S4100-0031 Rev. 42 11/2019



### **Operator Interface**

With the locking door closed, the glass window allows viewing of the display, status LEDs, and available operator switches. Features include a two-line by 40-character, wide viewing angle (super-twist) LCD with status LEDs and switches as shown in Figure 4.

LED indicators describe the general category of activity being displayed with the LCD providing more detail. For the authorized user, unlocking the door provides access to the control switches and allows further inquiry by scrolling the display for additional detail.

- · Convenient and extensive operator information is provided using a logical, menu-driven display
- · Multiple automatic and manual diagnostics for maintenance reduction
- Alarm and Trouble History Logs (up to 1000 entries for each, 2000 total events) are available for viewing from the LCD, or capable of being printed to a connected printer, or downloaded to a service computer
- Convenient PC programmer label editing
- · Password access control


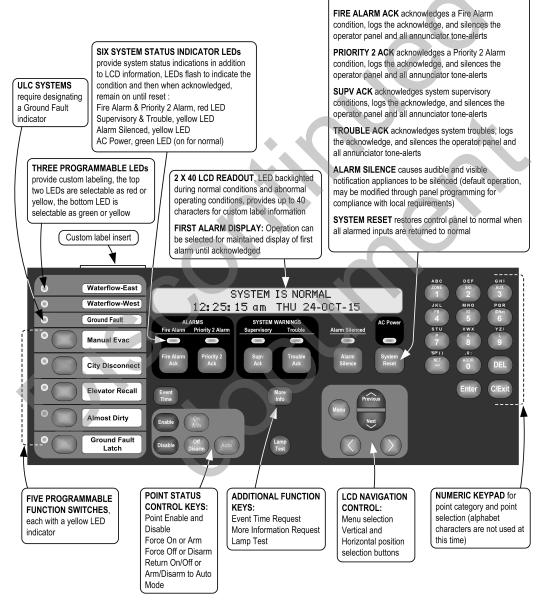


Figure 4: Operator Interface

Page 5 S4100-0031 Rev. 42 11/2019



# **Expansion Bay Module Loading Reference**

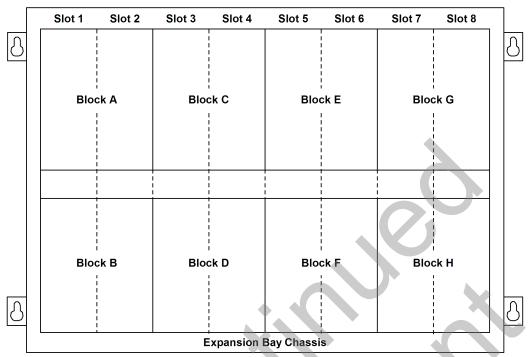

**Size Definitions**: Block = 4 in. W x 5 in. H (102 mm x 127 mm) card area Slot = 2 in. W x 8 in. H (51 mm x 203 mm) motherboard with daughter card

**Table 4: Expansion bay loading reference** 

| Description                   |                   | Mounting                |
|-------------------------------|-------------------|-------------------------|
| IDNet 2, IDNet 2+2 Modules    |                   | 1 Block                 |
| 4, 2 A Relays                 |                   | 1 block                 |
| 4, 10 A Relays                | NON Power-limited | 4 in., 2 slots          |
| 8, 3 A Relays                 |                   | 1 block                 |
| VESDA Interface               |                   | 2 in., 1 Slot           |
| Class B IDC                   |                   | 2 in., 1 Slot           |
| Class A IDC                   |                   | 2 in., 1 Slot           |
| MAPNET II Module              |                   | 4 in., 2 Slots          |
| MAPNET II/IDNet Isolator      |                   | 2 in., 1 Slot           |
| Decoder Module                |                   | 6 in., 3 Slots          |
| System or Remote Power Supply |                   | Blocks E, F, G & H ONLY |
| Expansion Power Supply        |                   | Blocks G & H ONLY       |
| NAC Expansion Module          |                   | On XPS ONLY             |

Page 6 S4100-0031 Rev. 42 11/2019

# **Simplex**

### Mounting and CPU Bay Module Reference

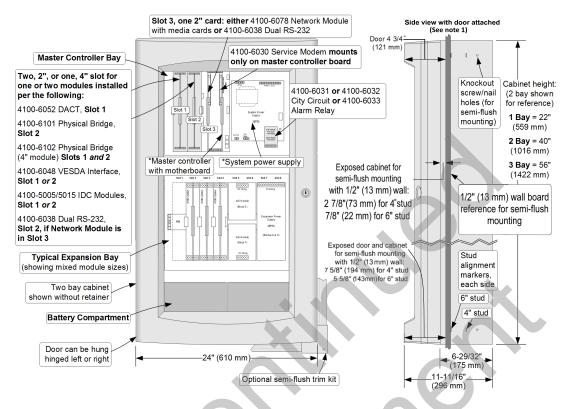


Figure 5: Mounting and CPU Bay Module Reference

### Note:

- 1. Side view dimensions are shown with minimal cabinet and door protrusion from the exterior wall. For 6 in. stud construction with minimum protrusion shown, the door will open 90 degrees. To allow the door to open 180 degrees, the exposed cabinet dimension from the exterior wall must be a minimum of 3 in. (76 mm) for both 4 in. and 6 in. stud construction.
- 2. Asterisks (\*) in Figure 5 indicate supplied modules.
- 3. A system ground must be provided for earth detection and transient protection devices. This connection shall be made to an approved, dedicated earth connection per NFPA 70, article 250, and NFPA 780.

Page 7 S4100-0031 Rev. 42 11/2019



# **General Specifications**

**Table 5: General Specifications** 

| Specifica                      | ation  |                                     |  | Rating   |  |   |                |
|--------------------------------|--|-------------------------------------|--|--|--|---|----------------|
| Input                          | System Power Supplies (SPS) Expansion Power Supplies (XPS) |                                     | 12<br>Mi<br>22                         |  | 4 A maximum  |   |                |
| Power                          | Remote Power Supplies (RPS)                                |                                     |  |  | 2 A maximum (<br>separate taps f   |   |                |
|                                | upply Output Ratings for SPS, XPS                          | Total Power Supply<br>Output Rating | outputs; 9 A to<br>appliances; 4       |  | d auxiliary power<br>Application"  | Output<br>switches<br>to battery<br>backup during |                |
| (nominal                       | 28 VDC on AC; 24 VDC on battery ba                         | Auxiliary Power Tap                 | 2 A maximum                            |  |  | mains AC<br>failure or                            |                |
|                                |  |                                     | NACs Programmed for<br>Auxiliary Power | 2 A maximum<br>maximum tota  | A maximum per NAC; 5 A 31.1 VDC  |   |                |
| Special Application Appliances |  |                                     |  | Simplex horns, strobes, and combination horn/strobes a speaker/strobes (contact your Simplex product represen for compatible appliances)                           |  |   | representative |
| Regulate                       | ed 24 DC Appliances  |                                     |  | Power for other UL listed appliances; use associated esynchronization modules where required   |  |   | ated external  |
| Battery                        | Charger Ratings for SPS and RPS                            | Battery capacity                    | range                                  | UL listed for battery charging of 6.2 Ah up to 110 Ah (batte<br>larger than 50 Ah require a remote battery cabinet); ULC li-<br>for charging up to 50 Ah batteries |  |   |                |
|                                |  | Charger characte                    | erformance                             |  | Temperature compensated, dual rate, recharges depleted batteries within 48 hours per UL Standard 864; to 70% cap in 12 hours per ULC Standard S527 |   |                |
| Operating Operating            |  | Operating Temp                      | erature                                | 32°F to 120°F (0°C to 49°C)  |  |   |                |
| EHVITONI                       | Environmental Operation                                    |                                     | dity                                   | Up to 93% RH, non-condensing @ 90°F (32°C) maximum   |  |   |                |
| Addition                       | nal Technical Reference                                    | Installation Instr                  | uctions                                | 574-848  |  |   |                |
| Addition                       | iai recimicai Neierence                                    | Operating Instructions              |  | 579-197  |  |   |                |
|                                |  |                                     |  |  |  |   |                |

# **Master Controller Selection Information**

### Notes for Table 6 and Table 7

- 1. Refer to data sheet \$4100-0045 for InfoAlarm Command Center expanded content display products.
- 2. Master Controller current does not subtract from 9 A output rating.
- 3. Supervisory and alarm currents are without IDNet devices. Add IDNet device currents seperately.

# Table 6: 4100ES Master Controller and Expansion Bay Selection (Canadian models have low battery cutout)

| Model  | Model Type and Listing   |                                   | Description  | Supv.  | Alarm  |
|--|--|-----------------------------------|--|--------|--------|
| 4100-9111<br>4100-9112<br>4100-9113<br>4100-9211 | 120 VAC Input English French 220-240 VAC Input                             | ULC<br>ULC                        | 4100ES Master Controller Assembly with LCD and operator interface, 9 A system power supply/battery charger (SPS), 250 point IDNet interface, three NACs, auxiliary relay, and external RUI + (isolated or un-isolated) communications interface              | 373 mA | 470 mA |
| 4100-9131<br>4100-9132<br>4100-9230              | 120 VAC Input<br>English, 120 VAC, Canadian<br>220 to 240 VAC Input        | UL<br>ULC<br>UL                   | 4100ES Master Controller Assembly, no display, no operator interface, 9 A system power supply/battery charger (SPS), 250 point IDNet interface, three NACs, auxiliary relay, and external RUI + (isolated or un-isolated) communications interface           | 363 mA | 425 mA |
| 4100-9121<br>(not ULC<br>listed)                 | controllers. Both bays have an LCD a supply (SPS) 120 VAC, 60 Hz input. Ac | nd opera<br>ctive SPS<br>Do not u | assembly, one for each of the primary and backup master<br>ator interface, CPU card assembly, and 9 A system power<br>battery charger in Bay 1 only. External RUI connections require<br>se circuit connections (IDNet, NACs, etc.) on primary and secondary | 718 mA | 937 mA |

Table 7: 4100ES Master Controller Upgrades for Existing 4100 Series Fire Alarm Control Panels

| Model     | Panel Type  | Includes  |
|-----------|---|---|
| 4100-7150 | 1000 pt 4100 (4100+)  | New Master Controller CPU card, 4100ES door assembly with LCD and user interface, and Ethernet connection   |
| 4100-7152 | 512 pt 4100   | Same as 4100-7150 plus a Universal Power Supply   |
| 4100-7158 | 4100U or1000 pt 4100<br>(4100+) previously<br>upgraded to 4100U | New Master Controller CPU card with Ethernet Connection Upgrade Kit (door assembly with LCD and user interface are not included) for: 4100U with or without LCD and operator interface, or4100+ without LCD and operator interface, or an existing 4100 (512 pt) or 4100+ (1000 pt) panel that was previously upgraded to a 4100U Master Controller and Display |

Page 8 S4100-0031 Rev. 42 11/2019



### **Table 8: Master Controller Accessories**

| Model     | Description  |
|-----------|--|
| 4100-2300 | Expansion Bay Assembly; order for each required expansion bay (not required for 4100-9121)   |
| 4100-2303 | Legacy Module Stabilizer Bracket, used when expansion bays have legacy slot style modules  |
|           | Expansion Bay Upgrade Kit for mounting 4100ES style (4 in. x 5 in. modules) in existing 4100 style panels;   |
| 4100-2301 | <b>Note:</b> When using this kit to upgrade a 4100+ transponder, a 4100-0620 Transponder Interface Card (TIC) is also required for communications to the 4100ES module |

### Table 9: Master Controller Upgrades for Existing 4020 Series Fire Alarm Control Panel

| Model     | Description   |
|-----------|---|
| 4100-9833 | 4020 Master Controller Upgrade to 4100ES; Includes New Master Controller with LCD & operator interface assembly, 8 VDC Converter and RUI+ (isolated or un-isolated) Interface in a single bay cabinet with locking glass door and retainer; mounts as an adjunct panel close-nippled to existing 4020 cabinet; also includes 8 VDC box-to-box power and communications harness and solid filler panel for the existing 4020 Master Controller bay |

### **Module Selection Information**

### **Current Calculation Notes**

To determine total supervisory current, add currents of modules in panel to base system value and all external loads powered by panel power supplies.

To determine total alarm current, add currents of modules in panel to base system alarm current and add all panel NAC loads and all external loads powered from panel power supplies.

### **Table 10: Communication Modules**

| Model     | Description             |   |             |                        | Size    | Supv.  | Alarm  |
|-----------|-------------------------|---|-------------|------------------------|---------|--------|--------|
| 4100-1291 |                         | it interface module (RUI); up to three  |             |                        | 1 Slot  | 85 mA  | 85 mA  |
| 4100-6030 |                         | ocal panel access only, mounts to Maricion, accesses same information as fr   |             |                        | N.A.    | 70 mA  | 70 mA  |
| 4100-6031 | Select one per SPS      | City Circuit, with disconnect switches  |             | For use with SPS only, | N.A.    | 20 mA  | 36 mA  |
| 4100-6032 | (fits on SPS)           | City Circuit, w/o disconnect switches   |             | not RPS                | N.A.    | 20 mA  | 36 mA  |
| 4100-6033 | (IILS OII SFS)          | Alarm Relay, 3 Form C relays, 2 A @   | 32 VDC; for | SPS or RPS             | N.A.    | 15 mA  | 37 mA  |
| 4100-6038 | Dual Port RS-232 with 3 | 2120 interface (slot module)  | 3 maxim     | um of RS-232 type      | 1 Slot  | 132 mA | 132 mA |
| 4100-6046 | Dual Port RS-232 stanc  | dard interface (4 in. x 5 in. module)   | modules     | per panel              | 1 Block | 60 mA  | 60 mA  |
| 4100-6045 | Decoder Module          |   |             |                        | 3 Slots | 85 mA  | 163 mA |
| 4100-6048 | VESDA Aspiration Syste  | em Interface  |             |                        | 1 Slot  | 132 mA | 132 mA |
| 4100-6052 |                         | eporting; one shipped unless 4100-7<br>080-9047 cables, 14 ft (4.3 m) long, R |             |                        | 1 Slot  | 30 mA  | 40 mA  |

# Table 11: Expansion, System and Remote Power Supplies (Canadian models have low battery cutout)

| Model     | Voltage/Listing     |             | Description   | Size     | Supv.  | Alarm  |
|-----------|---------------------|-------------|---|----------|--------|--------|
| 4100-5101 | 120 VAC UL          |             | <b>Expansion Power Supply (XPS)</b> ; 9 A output, three built-<br>in Class A/B NACs; NAC operation is same as SPS, see<br>Operator Interface for details        | 2 Blocks | 50 mA  | 50 mA  |
| 4100-5103 | 120 VAC, Canadian   | ULC         | <b>Expansion Power Supply (XPS)</b> ; 9 A output, three built-in Class A/B NACs; NAC operation is same as SPS, see Operator Interface for details               | 2 Blocks | 50 mA  | 50 mA  |
| 4100-5102 | 220 to 240 VAC      | UL          | <b>Expansion Power Supply (XPS)</b> ; 9 A output, three built-<br>in Class A/B NACs; NAC operation is same as SPS, see<br>Operator Interface for details        | 2 Blocks | 50 mA  | 50 mA  |
| 4100-5115 | NAC Expansion Modul | le, three N | NACs, Class A/B, mounts on XPS only   | N.A.     | 25 mA  | 25 mA  |
| 4100-5111 | 120 VAC             | UL          | Additional System Power Supply (SPS); 9 A power supply/charger with 250 point IDNet channel, three Class A/B NACs, add IDNet device currents separately         | 4 Blocks | 175 mA | 185 mA |
| 4100-5112 | 120 VAC, Canadian   | ULC         | <b>Additional System Power Supply (SPS)</b> ; 9 A power supply/charger with 250 point IDNet channel, three Class A/B NACs, add IDNet device currents separately | 4 Blocks | 175 mA | 185 mA |
| 4100-5113 | 220 to 240 VAC      | UL          | Additional System Power Supply (SPS); 9 A power supply/charger with 250 point IDNet channel, three Class A/B NACs, add IDNet device currents separately         | 4 Blocks | 175 mA | 185 mA |
| 4100-5125 | 120 VAC             | UL          | <b>Remote Power Supply (RPS)</b> ; 9 A power supply/charger similar to SPS except no IDNet channel or City Circuits; will accept one 4100-6033                  | 4 Blocks | 150 mA | 185 mA |

Page 9 S4100-0031 Rev. 42 11/2019



### Table 11: Expansion, System and Remote Power Supplies (Canadian models have low battery cutout)

| Model     | Voltage/Listing   |     | Description  | Size     | Supv.  | Alarm  |
|-----------|-------------------|-----|--|----------|--------|--------|
| 4100-5126 | 120 VAC, Canadian | ULC | <b>Remote Power Supply (RPS)</b> ; 9 A power supply/charger similar to SPS except no IDNet channel or City Circuits; will accept one 4100-6033 | 4 Blocks | 150 mA | 185 mA |
| 4100-5127 | 220 to 240 VAC    | UL  | <b>Remote Power Supply (RPS)</b> ; 9 A power supply/charger similar to SPS except no IDNet channel or City Circuits; will accept one 4100-6033 | 4 Blocks | 150 mA | 185 mA |

### **Table 12: Power supply accessories**

| Model     | Description   | Size  | Current                        |  |  |
|-----------|---|---|--------------------------------|--|--|
| 4100-5152 | 12 VDC Power Option, 2 A maximum  | 1 Block   | 1.5 A maximum                  |  |  |
| 4100-0156 | 8 VDC Converter, required for multiple Physical Bridge<br>Modules, 3 A maximum  | 1 Block   | included w/loads               |  |  |
| 4100-5130 | Voltage Regulator Module, 22.8 to 26.4 VDC (25VDC nominal); isolated and resettable output; includes earth detection circuit and trouble relay for status monitoring. | ated and resettable output; includes earth 1 Block 3 A maximum with 4 A load. |                                |  |  |
| 4100-0636 | Box Interconnection Harness Kit (non-audio); order one for each close-nippled cabinet   |   |                                |  |  |
| 4100-0638 | 4100 Slot Module Additional 24 VDC Harness; needed who  | en 4100 Slot module re  | quirements exceed 2 A from SPS |  |  |

### Table 13: Expansion Signal Module and Options (1.5 A Class B except as noted)

| Model     | Description                          |                       | Supv.  | Alarm |
|-----------|--------------------------------------|-----------------------|--------|-------|
| 4100-5116 | Converts one NAC in to three NACs of | ut; 1 Block size      | 18 mA  | 80 mA |
| 4100-1266 | Expands three NACs to six            | select one; mounts on | 0.6 mA | 60 mA |
| 4100-1267 | Converts three NACs to Class A       | 4100-5116             | 0.6 mA | 30 mA |

### **Table 14: 8 Zone Initiating Device Circuits**

| Model     | Туре    | Supv. | Alarm  |
|-----------|---------|-------|--------|
| 4100-5005 | Class B | 75 mA | 195 mA |
| 4100-5015 | Class A | 75 mA | 195 mA |

Note: Modules listed in Table 14 are for use with all 4100U systems and 4100ES systems version 3.03.05 or earlier. IDC Modules are 1 slot size.

### Table 15: 8-Point Zone/Relay Card

| Model     | Description   | Size    | Supv. | Alarm  |
|-----------|---|---------|-------|--------|
| 4100-5013 | 8 point zone/relay 4 in. x 5 in. flat module. Supports eight Class B or four Class A IDCs. Mounts in any open block in a master controller or expansion bay. Alarm current shown is for eight Class B IDCs using 3.3K end-of-line-resistors with four in alarm and four in standby. Standby current shown is for all eight IDCs in standby. Refer to 579-1236 Zone/Relay Module Installation Instructions for additional information. | 1 block | 83 mA | 295 mA |
| 4100-6305 | 25 V regulator harness for 8 point zone/relay module. One required for each 8 point zone/relay module to be powered by the 4100-5130 25 V regulator module. A maximum of five 8 point zone/relay modules may be powered from the 4100-5130 per bay.   | N/A     | N/A   | N/A    |

Note: Modules in Table 15 requires 4100ES Version 3.04.01 or later.

### **Table 16: IDNet Addressable Interface Modules**

| Model     | Description   |             | Supv.  | Alarm  |  |
|-----------|---|-------------|--------|--------|--|
|           | IDNet 2 Module, 250 point capacity; electrically isolated output with two   | no devices  | 50 mA  | 60 mA  |  |
| 4100-3109 | short circuit isolating Class B or Class A output loops, one block; standard  | 50 devices  | 90 mA  | 150 mA |  |
| 4100-3109 | on EPS with IDNet 2 Module; alarm currents for 50 and above devices   | 125 devices | 150 mA | 225 mA |  |
|           | includes 20 device LEDs in alarm  | 250 devices | 250 mA | 350 mA |  |
|           | IDNIA 2 2 2 Madula 250 paint consoit a plactainally included autout with  | no devices  | 50 mA  | 60 mA  |  |
| 4100-3110 | IDNet 2+2 Module, 250 point capacity; electrically isolated output with four short circuit isolating Class B or Class A output loops, one block;                                | 50 devices  | 90 mA  | 150 mA |  |
| 4100-3110 | alarm currents for 50 and above devices includes 20 device LEDs in alarm  | 125 devices | 150 mA | 225 mA |  |
|           | diatiff culterits for 50 and above devices includes 20 device LEDS iff diatiff  | 250 devices | 250 mA | 350 mA |  |
| 4100-3111 | IDNet Short Circuit Isolating Loop Output Module; mount up to two on a 4100-3109 module; for use with 4100-3109 modules; this option is for aftermarket field installation only |             |        |        |  |

**Note:** Loading per IDNet device (no LEDs on) = 0.8 mA supervisory and 1 mA alarm. Each IDNet 2 and IDNet 2+2 Short Circuit Isolating Loop Output can be individually controlled for system diagnostics and can be assigned a public point for Fire Alarm Network annunciation.

Page 10 S4100-0031 Rev. 42 11/2019



### **Table 17: MAPNET Addressable Interface Modules**

| Model     | Description  | Supv.   | Alarm  |        |  |
|-----------|--|---|--------|--------|--|
|           | MAPNET II Module, 127 point capacity, add  | Module without devices  | 255 mA | 275 mA |  |
| 4100-3102 | devices separately; Module size = 2 Slots; Loading per MAPNET II device = 1.7 mA | Fully loaded module, total  | 471 mA | 491 mA |  |
| 4100-3103 | SLC into four isolated outputs selectable as Class                               | ator Module for MAPNET II communications; converts a single connected into four isolated outputs selectable as Class A or Class B; up to two Isolator dules can be connected to one SLC; Module size = 1 Slot;  ie: |        |        |  |
|           | Compatible with MAPNET II Remote Isolators only                                  |   |        |        |  |

### Table 18: Relay Modules; Non power-limited (for mounting in expansion bay only)

| Model     | Description       | Resist | tive Ratings      | Inductiv | ve Ratings     | Size    | Supv. | Alarm  |
|-----------|-------------------|--------|-------------------|----------|----------------|---------|-------|--------|
| 4100-3202 | 4 DPDT w/feedback | 10 A   | 250 VAC           | 10 A     | 250 VAC        | 2 Slots | 15 mA | 175 mA |
| 4100-3204 | 4 DPDT w/feedback | 2 A    | 30 VDC/VAC        | 1/2 A    | 30 VDC/120 VAC | 1 Block | 15 mA | 60 mA  |
| 4100-3206 | 8 SPDT            | 3 A    | 30 VDC/120<br>VAC | 1 1/2 A  | 30 VDC/120 VAC | 1 Block | 15 mA | 190 mA |

#### **Table 19: System Option for Seismic Compliance**

| Model     | Description   |
|-----------|---|
| 4100-7912 | System option for Seismic compliance, provides additional stabilizer brackets required for legacy style cards |

### Table 20: End User Programming Software (requires 4100-8802)

| Model     | Description                   |  |  |  |  | , |
|-----------|-------------------------------|--|--|--|--|---|
| 4100-8802 | Programming Software (select) |  |  |  |  |   |

### Table 21: End User Programming Software Selection (select maximum of one each from below)

| Model     | Description  |
|-----------|--|
| 4100-0292 | Custom Labels Editing; allows editing of 40 Character Custom Labels for non-system user points   |
| 4100-0296 | Access Level/Passcode Editing; allows user to re-assign Access Levels and Passcodes for each display function; Acknowledge, Alarm  |
| 4100-0230 | Silence, System Reset, Point Enable/Disable, WALKTEST Enable/Disable, Clear History Logs, Change Time & Date, etc.   |
| 4100-0295 | Port Vectoring Setup and Control; Allows vectoring of events to PC Annunciator, Printers, LCD Annunciators, etc.   |
| 4100-0298 | WALKTEST Configuration Setup and Control; Allows user to create or edit WALKTEST groups used to test system initiating devices and signals by a single person, these groups allow an inspector to conduct a one-person WALKTEST in a specific area of a building (or different buildings), and limit the activation of the building signals to only the intended area; up to eight WALKTEST groups are supported |

### **Table 22: Miscellaneous Accessories**

| Model      | Description   |
|------------|---|
| 4100-1279  | Single blank 2 in. display cover; 4100-2302 provides a single plate for a full bay  |
| 4100-9856* | 4100ES Canadian French Appliqué Kit; Simplex, 4100ES, Contrôle Incendie   |
| 4100-9857* | 4100ES English Appliqué Kit; Simplex, 4100ES, Fire Control  |
| 4100-9858* | 4100ES InfoAlarm Remote Display English Appliqué Kit; Simplex, Operator Interface, 4100ES   |
| 4100-9859* | 4100ES InfoAlarm Remote Display Canadian French Appliqué Kit; Simplex, Interface de l'operateur, 4100ES                             |
| 4100-9868  | Special Purpose Appliqué Kit: Simplex, Elevator Recall Control and Supervisory Control Unit, 4100ES                                 |
| 4100-9869  | Special Purpose Appliqué Kit: Simplex, Sprinkler Waterflow and Supervisory Station, 4100ES  |
| 4100-9835  | Termination and Address Label Kit (for module marking); provides additional labels for field installed modules                      |
| 4100-6029  | Smoke Management Application Guide; required for UUKL listing   |
| 4100-6034  | Tamper Switch, one per cabinet assembly if required; monitors solid door for panels with solid door; monitors the internal retainer |
| 4100-0034  | panel for panels with glass door (not the glass door); has a built-in addressable IDNet IAM   |
| 2081-9031  | Series resistor for WSO, IDCs (N.O. water flow and tamper on same circuit, wires after water flow and before tamper) 470 Ω, 1 W,    |
| 2001-3031  | encapsulated, two 18 AWG leads (0.82 mm² ), 2 1/2 in. L x 1 3/8 in. W x 1 in. H (64 mm x 35 mm x 25 mm)                             |

**Note:** \* 4100ES English Appliqués are included with 4100ES Upgrade and Retrofit Kits for mounting 4100ES in 4100, 2120, 2001, and Autocall back boxes so that upgrades can be easily identified as 4100ES. 4100ES Appliqué Kits are available for applications such as to update Remote InfoAlarm Displays connected to a panel that was upgraded to 4100ES or for an existing 4100U when the New Master Controller is upgraded to 4100ES and only a software upgrade is required. When required, French appliqués are ordered separately.

### **Network Interface and Network Media Card Product Selection**

4100ES fire alarm control units are compatible with Simplex ES Net network or 4120 network fire alarm products.

- Refer to datasheet S4100-0076 for additional information on compatible ES Net fire alarm products.
- Refer to datasheet \$4100-0056 for additional information on compatible 4120 fire alarm products.

Page 11 S4100-0031 Rev. 42 11/2019



### Additional 4100ES and Network Product Reference

### Table 23: Additional 4100ES and Network Product Reference

| Serial DACT (SDACT) for 4100ES, 4010ES, 4007ES         \$2080-0009           Battery and Battery Cabinet Reference for 4100ES         \$2081-0006           \$110 Ah Batteries and Cabinets for 4100ES         \$2081-0019           \$2081-0019         \$4009 IDNET NAC Extender           \$4009 IDNET NAC Extender         \$4009-0002           \$4009 IDNAC Repeater         \$4009-0004           External 110 Ah Battery Charger for 4100ES, 4010ES         \$4009-0005           Graphic IVO Modules for 4100ES, 4010ES, 4007ES         \$4100-0005           Interface to VESDA Air Aspiration Detection Systems         \$4100-0026           4100ES LED/Switch Modules & Printer         \$4100-0032           Master Clock Interface         \$4100-0033           4100ES Emergency Voice/Alarm Equipment         \$4100-0034           MINIPLEX Transponders with SPS Power Supplies         \$4100-0034           MINIPLEX Transponders with SPS Power Supplies         \$4100-0036           4100ES Enclosures         \$4100-0036           4100ES Enclosures         \$4100-0036           4100ES Remote Annunciator Panels         \$4100-0038           4100ES Extinguishing Release Applications         \$4100-004           TEX Interface Module         \$4100-004           InfoAlarm Command Center with SPS Power Supplies         \$4100-0048           Multiple Signal  | Subject   | Data Sheet |
|--|---|------------|
| Battery and Battery Cabinet Reference for 4100ES   \$2081-0006   \$2081-0012   \$2081-0012   \$2081-0012   \$2081-0019   \$4009 IDNAt Act Extender   \$4009-0002   \$4009-0002   \$4009-0002   \$4009-0002   \$4009-0004   \$4009-0005   \$4009-0005   \$4009-0005   \$4009-0005   \$4009-0005   \$4009-0005   \$4009-0005   \$4009-0005   \$4009-0005   \$4009-0005   \$4009-0005   \$4009-0005   \$4009-0005   \$4009-0005   \$4009-0005   \$4009-0005   \$4009-0005   \$4009-0005   \$4009-0005   \$4009-00005   \$4 | Serial DACT (SDACT) for 4100ES, 4010ES, 4007ES      | S2080-0009 |
| Seismic Battery Brackets Reference   \$2081-0019   | Battery and Battery Cabinet Reference for 4100ES    | S2081-0006 |
| 4009 IDNAC Repeater       \$4009-0002         External 110 Ah Battery Charger for 4100ES, 4010ES       \$4009-0004         Graphic I/O Modules for 4100ES, 4010ES, 4007ES       \$4100-0005         Interface to VESDA Air Aspiration Detection Systems       \$4100-0026         4100ES LED/Switch Modules & Printer       \$4100-0032         Master Clock Interface       \$4100-0033         4100ES Emergency Voice/Alarm Equipment       \$4100-0034         MINIPLEX Transponders with SPS Power Supplies       \$4100-0035         NDU with SPS Power Supplies for 4120 Network       \$4100-0036         4100ES Enclosures       \$4100-0037         4100ES Remote Annunciator Panels       \$4100-0038         4100ES Extinguishing Release Applications       \$4100-0040         TFX Interface Module       \$4100-0042         InfoAlarm Command Center with SPS Power Supplies       \$4100-0042         2120 BMUX Module       \$4100-0048         Multiple Signal Fiber Optic Modems for 4120 Networks       \$4100-0049         BACpac Ethernet Module       \$4100-0051         4120 Network Products and Specifications       \$4100-0061         SafeLINC Internet Interface       \$4100-0062         Truelnsight Remote Gateway       \$4100-0063   |   | S2081-0012 |
| 4009 IDNAC Repeater       \$4009-0002         External 110 Ah Battery Charger for 4100ES, 4010ES       \$4009-0004         Graphic I/O Modules for 4100ES, 4010ES, 4007ES       \$4100-0005         Interface to VESDA Air Aspiration Detection Systems       \$4100-0026         4100ES LED/Switch Modules & Printer       \$4100-0032         Master Clock Interface       \$4100-0033         4100ES Emergency Voice/Alarm Equipment       \$4100-0034         MINIPLEX Transponders with SPS Power Supplies       \$4100-0035         NDU with SPS Power Supplies for 4120 Network       \$4100-0036         4100ES Enclosures       \$4100-0036         4100ES Remote Annunciator Panels       \$4100-0038         4100ES Extinguishing Release Applications       \$4100-0040         TEX Interface Module       \$4100-0042         InfoAlarm Command Center with SPS Power Supplies       \$4100-0042         2120 BMUX Module       \$4100-0048         Multiple Signal Fiber Optic Modems for 4120 Networks       \$4100-0049         BACpac Ethernet Module       \$4100-0051         4120 Network Products and Specifications       \$4100-0061         SafeLINC Internet Interface       \$4100-0062         Truelnsight Remote Gateway       \$4100-0063   | Seismic Battery Brackets Reference                  | S2081-0019 |
| External 110 Ah Battery Charger for 4100ES, 4010ES Graphic I/O Modules for 4100ES, 4010ES, 4007ES Interface to VESDA Air Aspiration Detection Systems 4100ES LED/Switch Modules & Printer S4100-0032 Master Clock Interface \$4100-0033 4100ES Emergency Voice/Alarm Equipment MINIPLEX Transponders with SPS Power Supplies NDU with SPS Power Supplies for 4120 Network 4100ES Enclosures \$4100-0036 4100ES Remote Annunciator Panels \$4100-0037 4100ES Extinguishing Release Applications TFX Interface Module InfoAlarm Command Center with SPS Power Supplies \$4100-0042 InfoAlarm Command Center with SPS Power Supplies \$4100-0048 Multiple Signal Fiber Optic Modems for 4120 Networks \$4100-0049 SA100-0049 SA100-0049 SA100-0049 SA100-0049 SA100-0049 SA100-0049 SA100-0056 SafeLINC Interrace Card (BNIC) S4100-0062 TrueInsight Remote Gateway   |   | S4009-0002 |
| Graphic I/O Modules for 4100ES, 4010ES, 4007ES Interface to VESDA Air Aspiration Detection Systems 4100-0026 4100ES LED/Switch Modules & Printer \$4100-0032 Master Clock Interface \$4100-0033 4100ES Emergency Voice/Alarm Equipment \$4100-0034 MINIPLEX Transponders with SPS Power Supplies \$4100-0035 NDU with SPS Power Supplies for 4120 Network \$4100-0036 4100ES Enclosures \$4100-0037 4100ES Remote Annunciator Panels \$4100-0038 4100ES Extinguishing Release Applications \$4100-0040 TFX Interface Module InfoAlarm Command Center with SPS Power Supplies \$4100-0045 2120 BMUX Module \$4100-0048 Multiple Signal Fiber Optic Modems for 4120 Networks \$4100-0051 4120 Network Products and Specifications \$4100-0056 Building Network Interface Card (BNIC) \$4100-0062 Truelnsight Remote Gateway  | 4009 IDNAC Repeater                                 | S4009-0004 |
| Interface to VESDA Air Aspiration Detection Systems 4100ES LED/Switch Modules & Printer  \$4100-0032  Master Clock Interface 4100ES Emergency Voice/Alarm Equipment 54100-0034  MiNIPLEX Transponders with SPS Power Supplies 54100-0035  NDU with SPS Power Supplies for 4120 Network 4100ES Enclosures 4100ES Enclosures 4100ES Enclosures 4100ES Extinguishing Release Applications 54100-0038  4100ES Extinguishing Release Applications 54100-0040  TFX Interface Module InfoAlarm Command Center with SPS Power Supplies 54100-0045  2120 BMUX Module 54100-0048  Multiple Signal Fiber Optic Modems for 4120 Networks 54100-0049  BACpac Ethernet Module 4120 Network Products and Specifications 54100-0056  Building Network Interface Card (BNIC) 54100-0062  TrueInsight Remote Gateway   | External 110 Ah Battery Charger for 4100ES, 4010ES  | S4081-0002 |
| 4100ES LED/Switch Modules & Printer  Master Clock Interface  \$4100-0033  4100ES Emergency Voice/Alarm Equipment  \$4100-0034  MINIPLEX Transponders with SPS Power Supplies  NDU with SPS Power Supplies for 4120 Network  \$4100-0036  4100ES Enclosures  \$4100-0037  4100ES Remote Annunciator Panels  \$4100-0038  4100ES Extinguishing Release Applications  TFX Interface Module  InfoAlarm Command Center with SPS Power Supplies  \$4100-0042  InfoAlarm Command Center with SPS Power Supplies  \$4100-0045  2120 BMUX Module  Multiple Signal Fiber Optic Modems for 4120 Networks  \$4100-0049  BACpac Ethernet Module  \$4100-0051  4120 Network Products and Specifications  \$4100-0056  Building Network Interface Card (BNIC)  \$4100-0062  TrueInsight Remote Gateway  \$4100-0063   | Graphic I/O Modules for 4100ES, 4010ES, 4007ES      | S4100-0005 |
| Master Clock Interface 4100ES Emergency Voice/Alarm Equipment 54100-0034 MINIPLEX Transponders with SPS Power Supplies 54100-0035 NDU with SPS Power Supplies for 4120 Network 54100-0036 4100ES Enclosures 4100ES Enclosures 54100-0037 4100ES Remote Annunciator Panels 54100-0038 4100ES Extinguishing Release Applications 54100-0040 TFX Interface Module InfoAlarm Command Center with SPS Power Supplies 54100-0042 InfoAlarm Command Center with SPS Power Supplies 54100-0045 2120 BMUX Module Multiple Signal Fiber Optic Modems for 4120 Networks 54100-0049 BACpac Ethernet Module 4120 Network Products and Specifications 54100-0056 Building Network Interface Card (BNIC) 54100-0062 Truelnsight Remote Gateway 54100-0063   | Interface to VESDA Air Aspiration Detection Systems | S4100-0026 |
| 4100ES Emergency Voice/Alarm Equipment  MINIPLEX Transponders with SPS Power Supplies  NDU with SPS Power Supplies for 4120 Network  4100ES Enclosures  4100ES Enclosures  4100ES Remote Annunciator Panels  4100ES Extinguishing Release Applications  TFX Interface Module  InfoAlarm Command Center with SPS Power Supplies  2120 BMUX Module  Multiple Signal Fiber Optic Modems for 4120 Networks  BACpac Ethernet Module  4120 Network Products and Specifications  S4100-0049  Ballding Network Interface Card (BNIC)  SafeLINC Internet Interface  TrueInsight Remote Gateway  S4100-0063  |   | S4100-0032 |
| MINIPLEX Transponders with SPS Power Supplies  NDU with SPS Power Supplies for 4120 Network  4100ES Enclosures  4100ES Remote Annunciator Panels  4100ES Extinguishing Release Applications  TFX Interface Module  InfoAlarm Command Center with SPS Power Supplies  2120 BMUX Module  Multiple Signal Fiber Optic Modems for 4120 Networks  BACpac Ethernet Module  4120 Network Products and Specifications  S4100-0049  Ballding Network Interface Card (BNIC)  SafeLINC Internet Interface  S4100-0063  S4100-0063  S4100-0063   | Master Clock Interface                              | S4100-0033 |
| NDU with SPS Power Supplies for 4120 Network  4100ES Enclosures  4100ES Remote Annunciator Panels  4100ES Extinguishing Release Applications  54100-0038  4100ES Extinguishing Release Applications  54100-0040  TFX Interface Module  InfoAlarm Command Center with SPS Power Supplies  2120 BMUX Module  Multiple Signal Fiber Optic Modems for 4120 Networks  54100-0049  BACpac Ethernet Module  54100-0051  4120 Network Products and Specifications  54100-0056  Building Network Interface Card (BNIC)  SafeLINC Internet Interface  54100-0063  TrueInsight Remote Gateway  54100-0063   |   | S4100-0034 |
| 4100ES Enclosures  4100ES Remote Annunciator Panels  4100ES Extinguishing Release Applications  54100-0038  4100ES Extinguishing Release Applications  54100-0040  TFX Interface Module  InfoAlarm Command Center with SPS Power Supplies  2120 BMUX Module  54100-0045  2120 BMUX Module  54100-0048  Multiple Signal Fiber Optic Modems for 4120 Networks  54100-0049  BACpac Ethernet Module  4120 Network Products and Specifications  54100-0056  Building Network Interface Card (BNIC)  SafeLINC Internet Interface  54100-0062  TrueInsight Remote Gateway  54100-0063   |   | S4100-0035 |
| 4100ES Remote Annunciator Panels  4100ES Extinguishing Release Applications  TFX Interface Module  InfoAlarm Command Center with SPS Power Supplies  2120 BMUX Module  Multiple Signal Fiber Optic Modems for 4120 Networks  BACpac Ethernet Module  4120 Network Products and Specifications  S4100-0056  Building Network Interface Card (BNIC)  SafeLINC Internet Interface  TrueInsight Remote Gateway  S4100-0063   |   | S4100-0036 |
| 4100ES Extinguishing Release Applications  TFX Interface Module  InfoAlarm Command Center with SPS Power Supplies  2120 BMUX Module  Multiple Signal Fiber Optic Modems for 4120 Networks  BACpac Ethernet Module  4120 Network Products and Specifications  S4100-0056  Building Network Interface Card (BNIC)  SafeLINC Internet Interface  TrueInsight Remote Gateway  S4100-0063   |   | S4100-0037 |
| TFX Interface Module InfoAlarm Command Center with SPS Power Supplies 2120 BMUX Module S4100-0048 Multiple Signal Fiber Optic Modems for 4120 Networks S4100-0049 BACpac Ethernet Module 4120 Network Products and Specifications S4100-0056 Building Network Interface Card (BNIC) SafeLINC Internet Interface TrueInsight Remote Gateway S4100-0063  | 4100ES Remote Annunciator Panels                    | S4100-0038 |
| InfoAlarm Command Center with SPS Power Supplies  2120 BMUX Module  S4100-0048  Multiple Signal Fiber Optic Modems for 4120 Networks  S4100-0049  BACpac Ethernet Module  4120 Network Products and Specifications  S4100-0056  Building Network Interface Card (BNIC)  SafeLINC Internet Interface  S4100-0062  TrueInsight Remote Gateway  S4100-0063  |   |            |
| 2120 BMUX Module  Multiple Signal Fiber Optic Modems for 4120 Networks  S4100-0049  BACpac Ethernet Module  54100-0051  4120 Network Products and Specifications  S4100-0056  Building Network Interface Card (BNIC)  SafeLINC Internet Interface  TrueInsight Remote Gateway  S4100-0063  |   | S4100-0042 |
| Multiple Signal Fiber Optic Modems for 4120 Networks  S4100-0049  BACpac Ethernet Module  \$4100-0051  4120 Network Products and Specifications  S4100-0056  Building Network Interface Card (BNIC)  SafeLINC Internet Interface  S4100-0062  TrueInsight Remote Gateway  \$4100-0063  | InfoAlarm Command Center with SPS Power Supplies    | S4100-0045 |
| BACpac Ethernet Module  4120 Network Products and Specifications  S4100-0056  Building Network Interface Card (BNIC)  SafeLINC Internet Interface  TrueInsight Remote Gateway  S4100-0063  |   |            |
| 4120 Network Products and Specifications  S4100-0056  Building Network Interface Card (BNIC)  SafeLINC Internet Interface  TrueInsight Remote Gateway  S4100-0063  |   |            |
| Building Network Interface Card (BNIC)  SafeLINC Internet Interface  TrueInsight Remote Gateway  S4100-0063  S4100-0063  |   |            |
| SafeLINC Internet Interface S4100-0062 TrueInsight Remote Gateway S4100-0063   |   |            |
| Truelnsight Remote Gateway S4100-0063  |   |            |
|  |   |            |
| FCALAN - 1 D 1 - 16 'S 'S 'S   |   |            |
|  | ES Net Network Products and Specifications          | S4100-0076 |
| NDU with SPS Power Supplies for ES Net S4100-0077  |   |            |
| 4100ES Basic Panels with EPS Power Supplies \$4100-0100  |   |            |
| InfoAlarm Command Center with EPS Power Supplies \$4100-0101   |   |            |
| NDU with EPS Power Supplies for 4120 Network \$4100-0102   |   |            |
| MINIPLEX Transponders with EPS Power Supplies \$4100-0103  |   |            |
| NDU with EPS Power Supplies for ES Net S4100-0104  |   |            |
| PC Annunciator S4190-0013  |   |            |
| TrueSite Workstation \$4190-0016   |   |            |
| Network System Integrator (NSI) for 4120 Networks \$4190-0017  |   |            |
| TrueSite Incident Commander \$4190-0020  |   |            |
| 24-Pin Dot Matrix Fire Alarm System Remote Printer \$4190-0027   |   |            |
| SCU/RCU Annunciators for 4007ES, 4010ES, 4100ES <b>\$4602-0001</b>   |   |            |
| LCD Annunciator for 4100ES S4603-0001  | LCD Annunciator for 4100ES                          | S4603-0001 |

<sup>© 2019</sup> Johnson Controls. All rights reserved. All specifications and other information shown were current as of document revision and are subject to change without notice. Additional listings may be applicable, contact your local Simplex® product supplier for the latest status. Listings and approvals under Simplex Time Recorder Co. Simplex, and the product names listed in this material are marks and/or registered marks. Unauthorized use is strictly prohibited. NFPA 72 and National Fire Alarm Code are registered trademarks of the National Fire Protection Association (NFPA).